


# Dry Hydrant Diagram

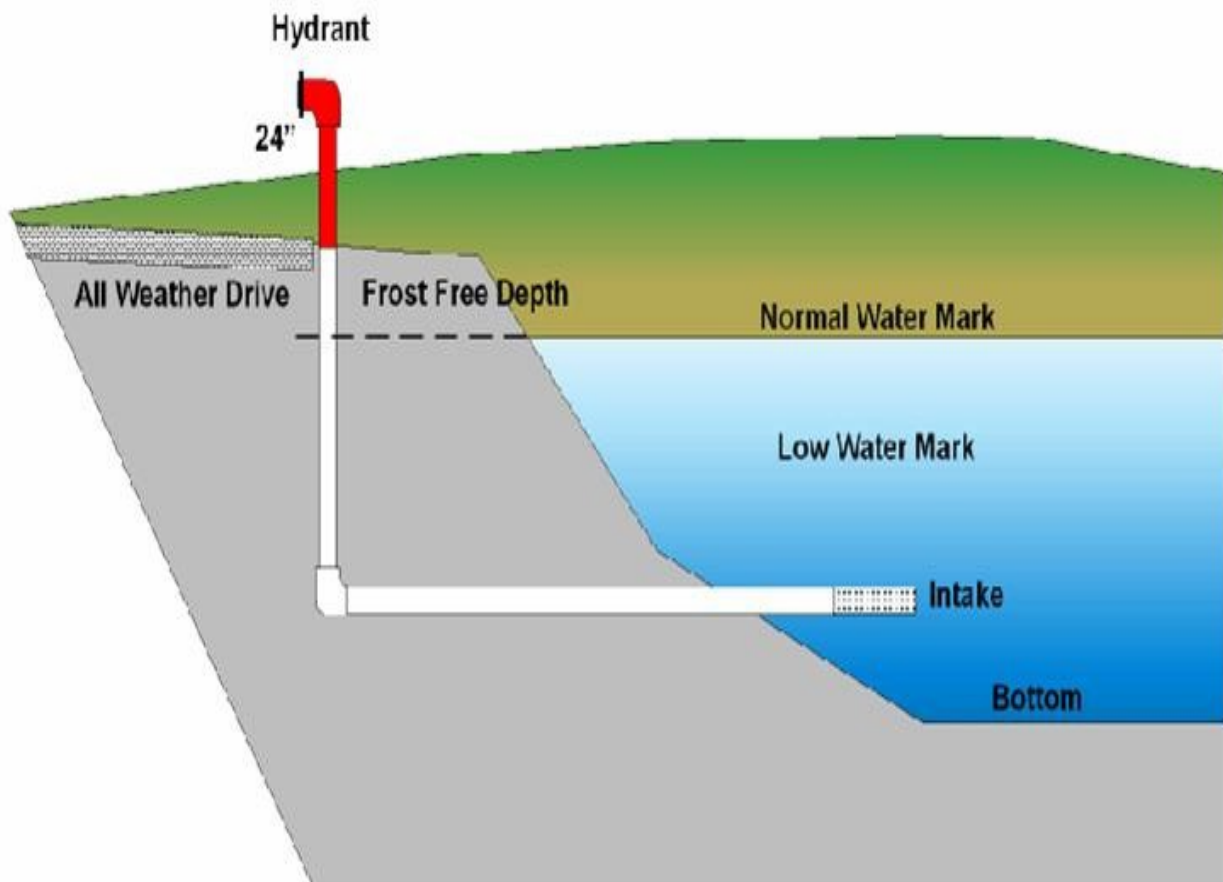

## Minimum Requirements

- Pond must be minimum 7-8 foot deep
- Must be accessible to fire department, including all weather drive
- Hydrant Head must meet appropriate size requirements for fire department in your community
- Must be maintained on a regular basis to prevent clogging
- A minimum of 30,000 gallons are needed to function properly (250 gpm for 2 hours) during drought conditions
- Locate all utilities before performing excavation work by calling Ohio Utilities Protection Service (OUPS) at 1-800-362-2764 before work begins